



GRP Australia Pty Ltd - MG3838-standard Grit Surface GRP Grating - Wet Sliptest BO270918-9

27 Sep 2018

Slip Resistance Classification of New Pedestrian Surfaces - AS4586:2013 Appendix A

Date Tested:	27 Sep 2018
Test Report Number:	BO270918-9
Client Name & Address:	GRP Australia Pty Ltd - Unit 14 / 67 O'Connell Tce, Bowen Hills, QLD 4006
Test Site / Project :	GRP Australia Warehouse - 6 Hurricane Street, Banyo, QLD 4014
Product / Sample Tested :	MG3838-standard Grit Surface GRP Grating
Wet Pendulum Test carried out using :	Slider 55 (TRL) Rubber slider
Record ambient temperature (°C)	22
Temperature Correction for Type 55 (TRL) Rubber Slider	18-23 = 0
Testing Officer :	Blair Ording - Munro-Stanley Portable Skid Tester #1133 - 30.08.17
Testing Officer Signature	

Test Results :

No. of Samples	Sample No.	Swing 1	Swing 2	Swing 3	Swing 4	Swing 5	Mean BPN of last 3 swings :	Surface Picture
1	Area 1	85	80	77	77	77	77	
	Area 2	80	80	80	79	79	79	
	Area 3	80	80	79	79	79	79	
	Area 4	75	75	75	75	75	75	
	Area 5	80	80	80	80	80	80	


Mean BPN Slip Resistance Value (SRV)	78
Corrected Mean BPN (SRV) Slider 55 ONLY	79
CLASSIFICATION using Slider 55 (TRL Slider)	P5 =>44

Accredited for Compliance with ISO/IEC 17025. The information presented herein and on the Sliptest Report is copyright and is protected by copyright law, any reproduction of this information and test report except in full is prohibited. Sliptest Australia Pty. Ltd. performed this on site test with reference to the following Australian Standard testing criteria, of AS 4586:2013 Classification of new pedestrian surface materials. Appendix A – Wet Pendulum Test Method and Hand Book HB 198: 2014 with reference to AS/NZS 4663: 2004 Slip Resistance measurement of existing pedestrian surfaces and HB 197: 1999. These results do not account for Future Wear, Maintenance or Contamination of this surface once in-situ.

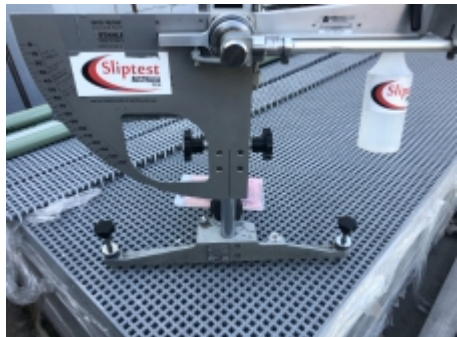
GRP Australia Pty Ltd - MG1930-Standard Grit Surface GRP Grating - Wet Sliptest - BO270918-8

27 Sep 2018

Slip Resistance Classification of New Pedestrian Surfaces - AS4586:2013 Appendix A

Date Tested:	27 Sep 2018
Test Report Number:	BO270918-8
Client Name & Address:	GRP Australia Pty Ltd - Unit 14 / 67 O'Connell Tce, Bowen Hills, QLD 4006
Test Site / Project :	GRP Australia Warehouse - 6 Hurricane Street, Banyo, QLD 4014
Product / Sample Tested :	MG1930-Standard Grit surface GRP Grating - Rough Finish
Wet Pendulum Test carried out using :	Slider 55 (TRL) Rubber slider
Record ambient temperature (°C)	22
Temperature Correction for Type 55 (TRL) Rubber Slider	18-23 = 0
Testing Officer :	Blair Ording - Munro-Stanley Portable Skid Tester #1133 - 30.08.17
Testing Officer Signature	

Test Results :

No. of Samples	Sample No.	Swing 1	Swing 2	Swing 3	Swing 4	Swing 5	Mean BPN of last 3 swings :	Surface Picture
1	Area 1	75	75	75	75	75	75	
	Area 2	75	75	75	75	75	75	
	Area 3	75	75	75	75	75	75	
	Area 4	75	75	75	75	75	75	
	Area 5	75	75	74	74	74	74	

Mean BPN Slip Resistance Value (SRV)	75
Corrected Mean BPN (SRV) Slider 55 ONLY	75
CLASSIFICATION using Slider 55 (TRL Slider)	P5 =>44

Accredited for Compliance with ISO/IEC 17025. The information presented herein and on the Sliptest Report is copyright and is protected by copyright law, any reproduction of this information and test report except in full is prohibited. Sliptest Australia Pty. Ltd. performed this on site test with reference to the following Australian Standard testing criteria, of AS 4586:2013 Classification of new pedestrian surface materials. Appendix A – Wet Pendulum Test Method and Hand Book HB 198: 2014 with reference to AS/NZS 4663: 2004 Slip Resistance measurement of existing pedestrian surfaces and HB 197: 1999. These results do not account for Future Wear, Maintenance or Contamination of this surface once in-situ.


**GRP Australia Pty Ltd - MG3828-Diamond Top GRP Flooring - Wet Sliptest
BO270918-7**

27 Sep 2018

Slip Resistance Classification of New Pedestrian Surfaces - AS4586:2013 Appendix A

Date Tested:	27 Sep 2018
Test Report Number:	BO270918-7
Client Name & Address:	GRP Australia Pty Ltd - Unit 14 / 67 O'Connell Tce, Bowen Hills, QLD 4006
Test Site / Project :	GRP Australia Warehouse - 6 Hurricane Street, Banyo, QLD 4014
Product / Sample Tested :	MG3828-Diamond Top GRP Flooring
Wet Pendulum Test carried out using :	Slider 55 (TRL) Rubber slider
Record ambient temperature (°C)	22
Temperature Correction for Type 55 (TRL) Rubber Slider	18-23 = 0
Testing Officer :	Blair Ording - Munro-Stanley Portable Skid Tester #1133 - 30.08.17
Testing Officer Signature	

Test Results :

No. of Samples	Sample No.	Swing 1	Swing 2	Swing 3	Swing 4	Swing 5	Mean BPN of last 3 swings :	Surface Picture
1	Area 1	90	90	90	90	90	90	
	Area 2	86	86	86	86	85	86	
	Area 3	80	80	80	80	80	80	
	Area 4	80	80	79	79	79	79	
	Area 5	80	80	79	79	70	76	

Mean BPN Slip Resistance Value (SRV)	82
Corrected Mean BPN (SRV) Slider 55 ONLY	82
CLASSIFICATION using Slider 55 (TRL Slider)	P5 =>44

Accredited for Compliance with ISO/IEC 17025. The information presented herein and on the Sliptest Report is copyright and is protected by copyright law, any reproduction of this information and test report except in full is prohibited. Sliptest Australia Pty. Ltd. performed this on site test with reference to the following Australian Standard testing criteria, of AS 4586:2013 Classification of new pedestrian surface materials. Appendix A – Wet Pendulum Test Method and Hand Book HB 198: 2014 with reference to AS/NZS 4663: 2004 Slip Resistance measurement of existing pedestrian surfaces and HB 197: 1999. These results do not account for Future Wear, Maintenance or Contamination of this surface once in-situ.